



TEOM 1405-DF Inside


PM Mass Concentration (07/25/16)

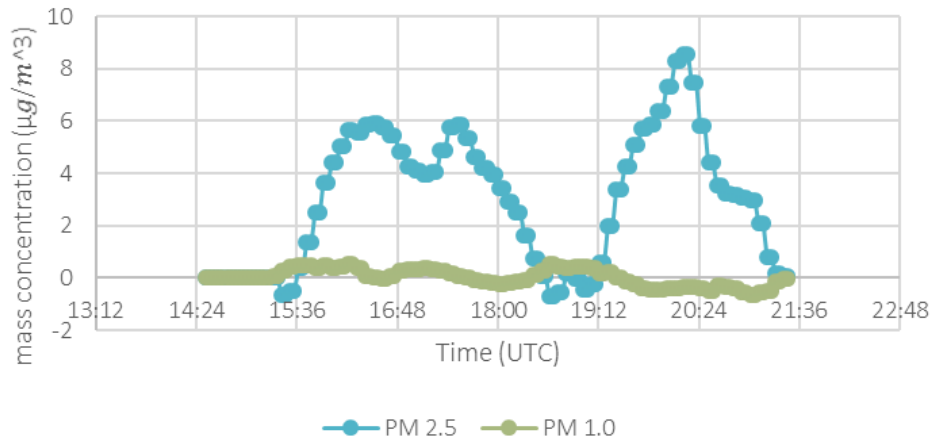

PM Mass Concentration (07/26/16)

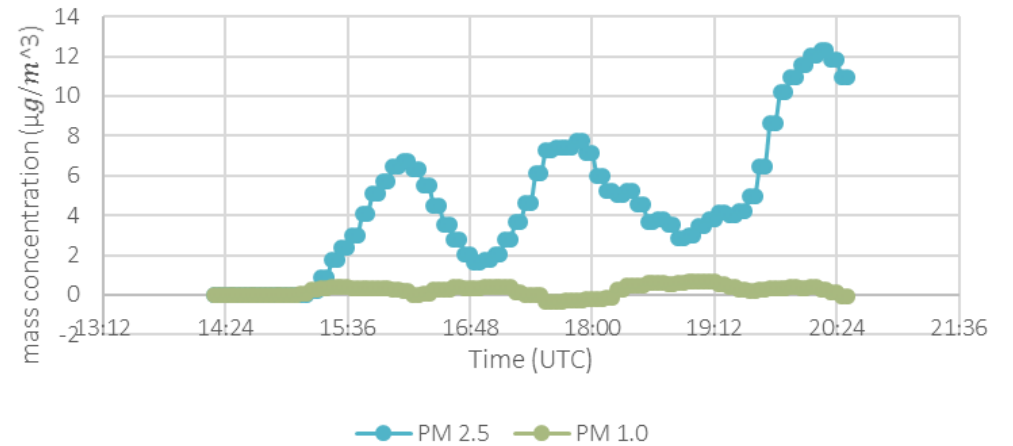


TEOM 1405-DF Outside

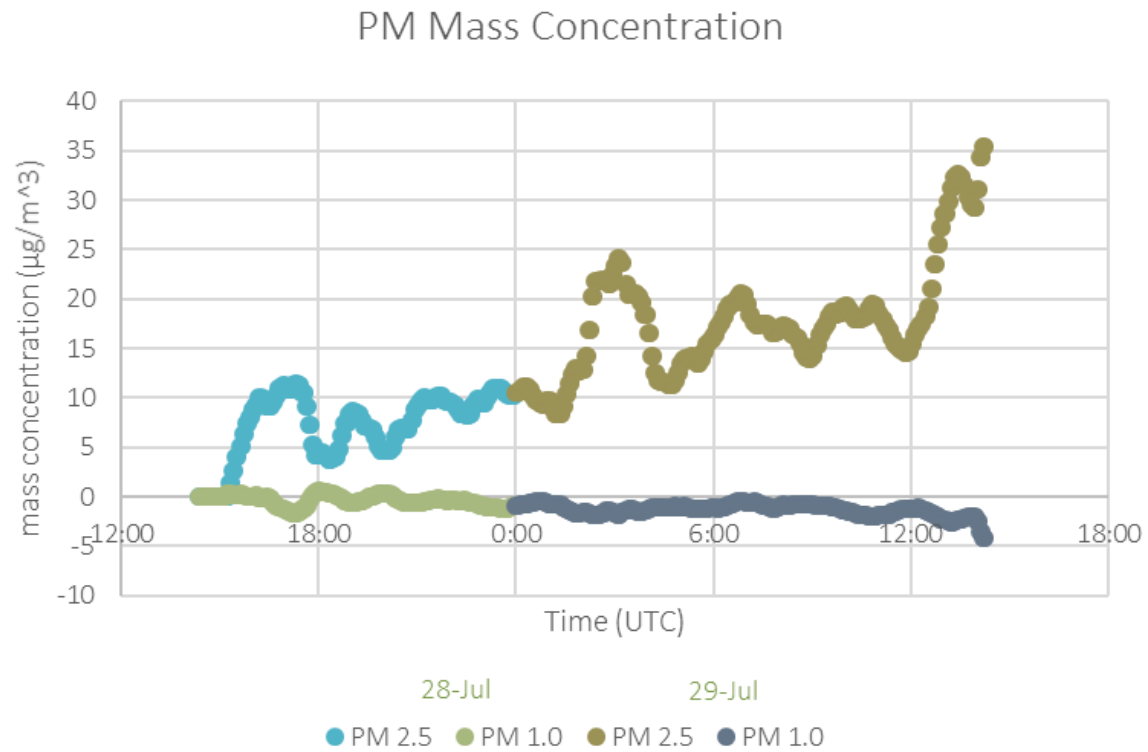


CPC Inside


Concentration Vs. Time (07/25/16)

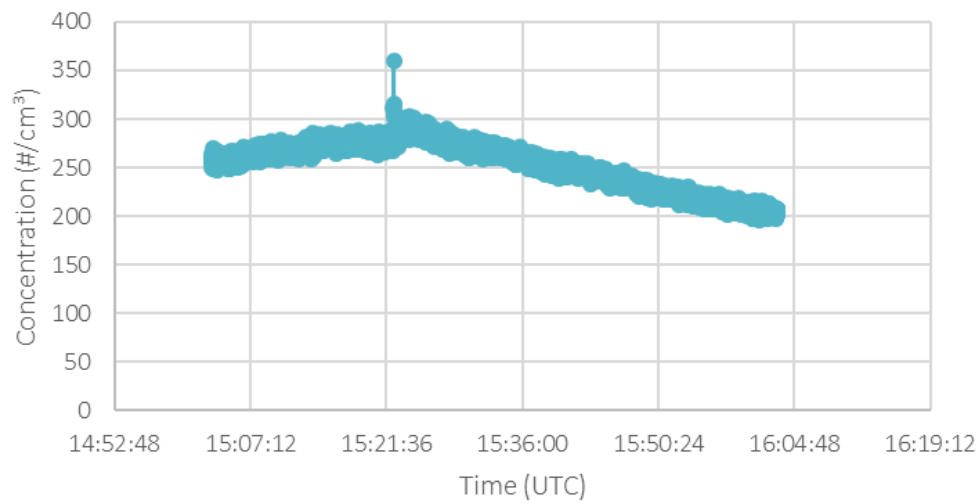

Concentration Vs. Time (07/26/16)

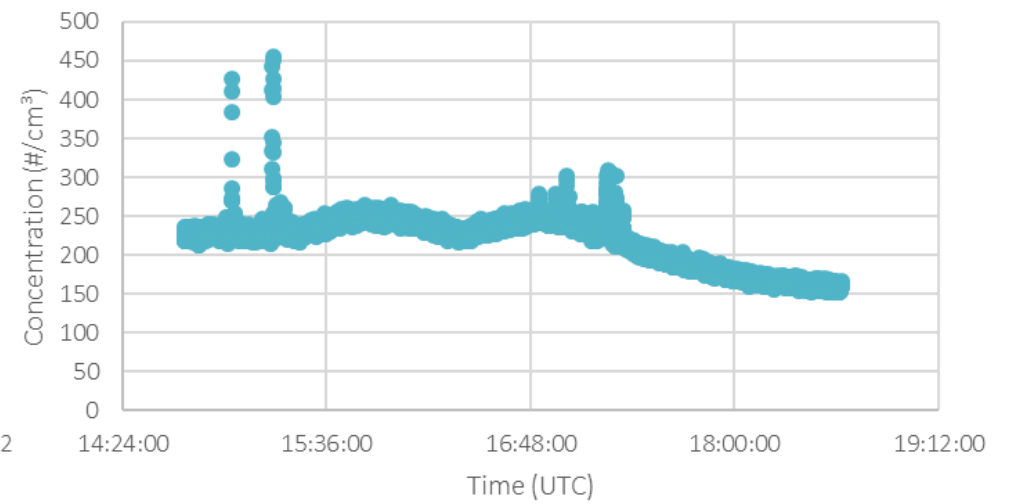


CPC Outside

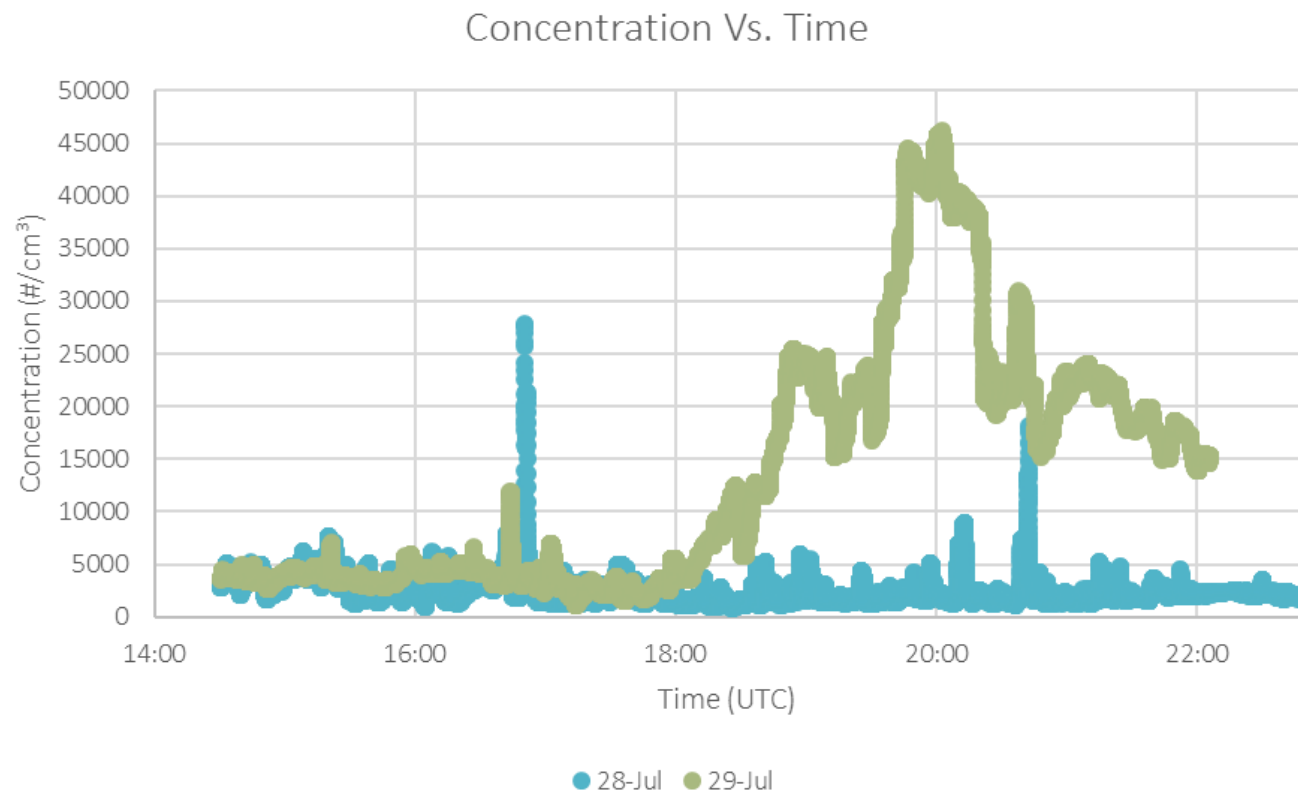


Gas Analyzers Inside

Gas Concentrations Vs Time (07/25/16)

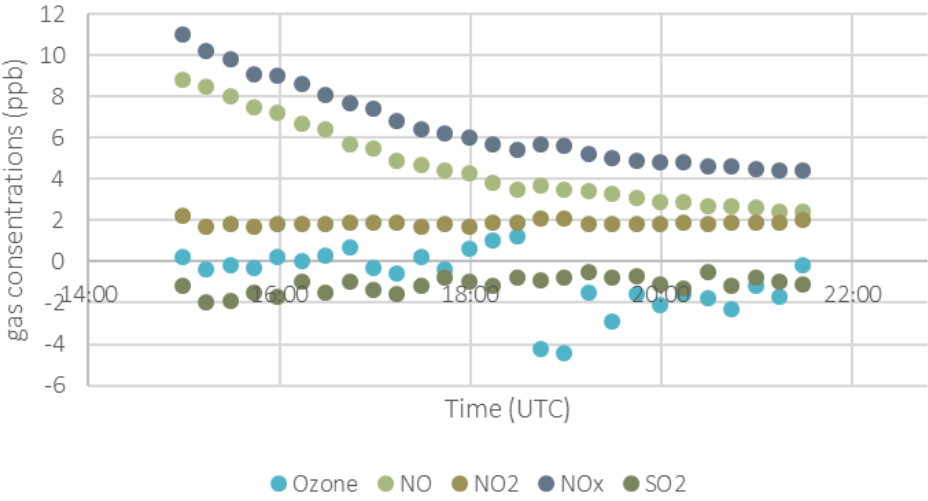


Gas Concentrations Vs Time (07/26/16)

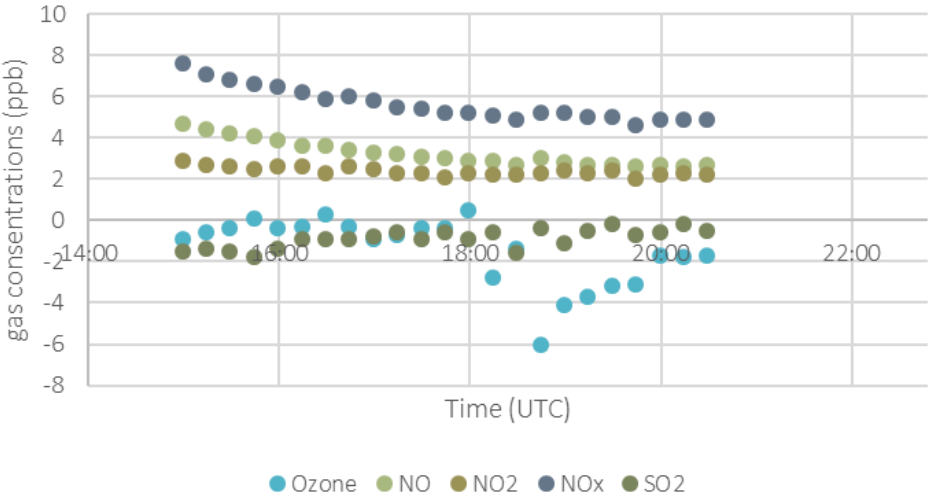


Gas Analyzers Outside

Gas Concentrations Vs. Time (07/28/16)

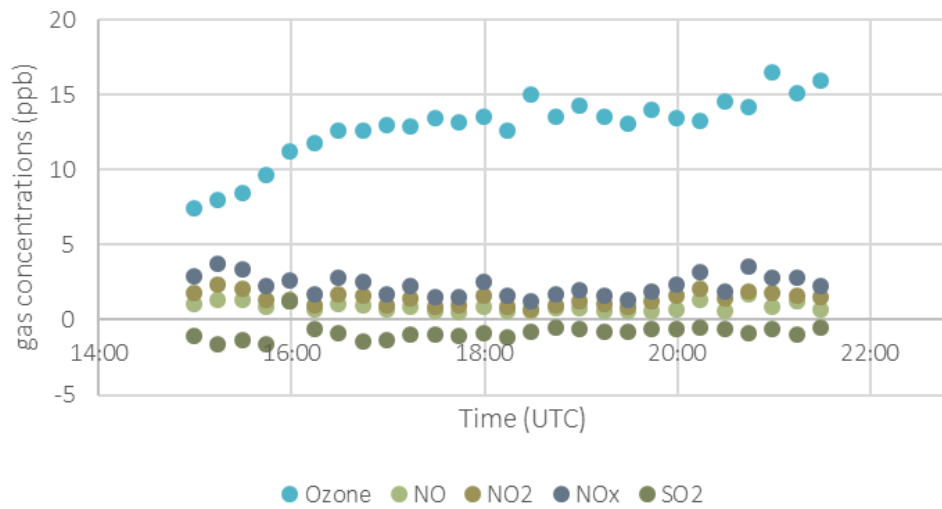

Gas Concentrations Vs. Time (07/29/16)

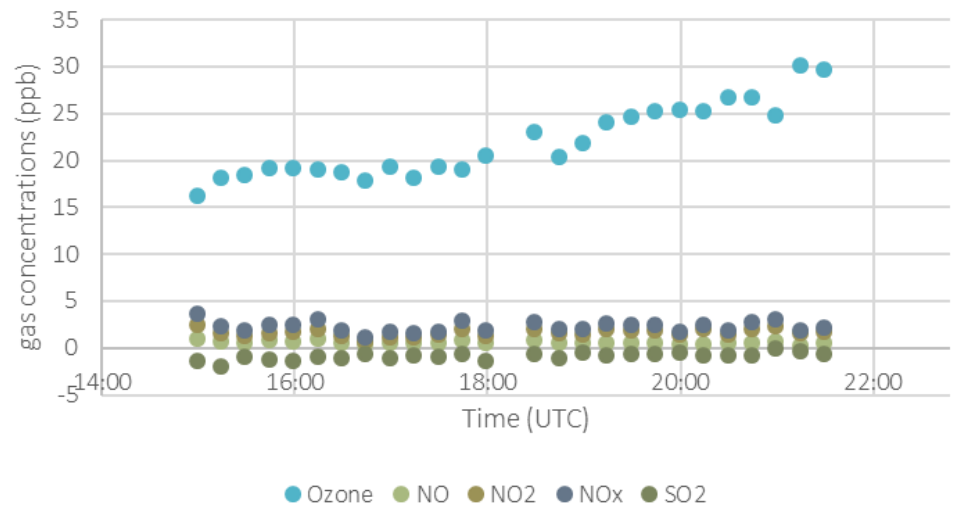

AQI Inside vs. Outside

